
CNPJ: 49.563.117/0001-72 METALÚRGICA CONVENÇÃO DE ITU LTDA.



Telefones: (11) 4013-7223

AV. SETE QUEDAS, 1.028 - VILA PADRE BENTO | ITU/SP - BRASIL

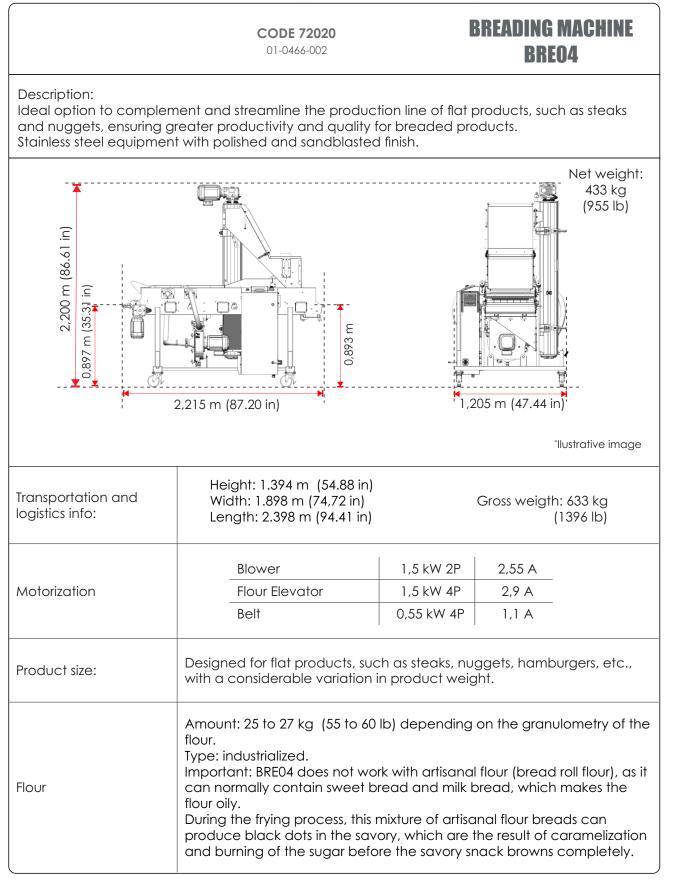

12/09/2024

Review 00.24

page 1





CNPJ: 49.563.117/0001-72 METALÚRGICA CONVENÇÃO DE ITU LTDA.

Telefones: (11) 4013-7223

AV. SETE QUEDAS, 1.028 - VILA PADRE BENTO | ITU/SP - BRASIL

Blower/ fan	Remove excess breading flour				
Belt width	510 mm (20.08 in)				
	Electric Total Consumption current	Gauge or phase	Gauge the ground *	Plug	Exclusive circuit breaker
Electrical data:	4.0 kW 10 A	4 mm ²	4 mm ²	pp 3x4 mm² cable	Three polar 16 A
480 V - THREE PHASE	*.The MCI breading be installed with suitable electrical grounding. Failure to elctrical grounding may cause electric damages. For your safety, ask for an electrician youtrust to check the condition of the power grid of the equipment installation site.				
Electrical panel:	Activates the conveyor movement command Activate the flour elevator Activate the blower FLOUR ELEVATOR FLOUR BLOWER				

